

IS : 2546 - 1974
(Reaffirmed 2000)
Edition 2.2
(2001-02)

Indian Standard
SPECIFICATION FOR
GALVANIZED MILD STEEL FIRE BUCKET
(*First Revision*)

(Incorporating Amendment Nos. 1 & 2)

UDC 614.843.5 [669.141.24:669.586]

© BIS 2003

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

Price Group 2

Indian Standard
SPECIFICATION FOR
GALVANIZED MILD STEEL FIRE BUCKET
(First Revision)

Fire Fighting Sectional Committee, BDC 22

<i>Chairman</i>	<i>Representing</i>
SHRI P. N. MEHROTRA	Ministry of Home Affairs
<i>Members</i>	
SHRI G. B. MENON (<i>Alternate to</i> Shri P. N. Mehrotra)	Central Building Research Institute (CSIR), Roorkee
DR G. N. BADAMI	Insurance Association of India, Bombay
SHRI GOPAL KRISHAN (<i>Alternate</i>)	Air Foam Industries, New Delhi
SHRI P. K. BHARUCHA	West Bengal Fire Services, Calcutta
SHRI A. CHATTERJI (<i>Alternate</i>)	National Safety Council, Bombay
SHRI M. B. CHAKANKAR	Bhaba Atomic Research Centre, Trombay, Bombay
SHRI R. MEHTA (<i>Alternate</i>)	Home (Police) Department, Government of Andhra Pradesh
SHRI S. C. CHATTERJEE	Ministry of Defence (R & D)
BRIG P. R. CHAUHAN	Avon Services (Production & Agencies) Private Limited, New Delhi
SHRI R. R. DHOBLEY	Bombay Fire Brigade, Bombay
DIRECTOR, FIRE SERVICE	Allen Richards & Co, Calcutta
SHRI P. N. GHOSH	Minimax Ltd, Calcutta
SHRI A. N. AHLUWALIA (<i>Alternate</i>)	Ministry of Railways
DR D. S. JAISWAR	Fire Service, Government of Tamilnadu, Madras
SHRI A. S. KULKARNI	Directorate General of Civil Aviation (Ministry of Tourism & Civil Aviation), New Delhi
SHRI D. K. MAJUMDER	Ministry of Defence (DGI)
SHRI A. K. MITRA (<i>Alternate</i>)	
SHRI D. M. B. MAJUMDER	
SHRI S. C. DUTTA (<i>Alternate</i>)	
SHRI S. P. NAG	
SHRI R. NITYANANDAM	
SHRI N. DEVARAJAN (<i>Alternate</i>)	
SHRI H. C. RAI CHAUDHARY	
LT-COL B. N. S. RAO	
MAJ B. B. RAJPAL (<i>Alternate</i>)	

(Continued on page 2)

© BIS 2003

BUREAU OF INDIAN STANDARDS

This publication is protected under the *Indian Copyright Act* (XIV of 1957) and reproduction in whole or in part by any means except with written permission of the publisher shall be deemed to be an infringement of copyright under the said Act.

IS : 2546 - 1974

(Continued from page 1)

Members

SHRI K. RAMAKRISHNA RAO
SHRI P. L. SEBASTIN
SHRI V. V. KIMMATKAR (*Alternate*)
SHRI G. C. SENAPATI
SHRI P. CHATTERJEE (*Alternate*)
SHRI P. H. SETHNA
SHRI N. T. PANJWANI (*Alternate*)
SHRI J. V. SHAH
SHRI M. K. SHAH (*Alternate*)
SHRI V. N. SHARMA
SHRI F. E. BRAIN (*Alternate*)
SHRI C. R. SIRCAR
SHRI D. K. SIRKAR
SHRI R. S. SUNDARAM
SHRI N. P. VERGHESE
SHRI B. V. WAGLE
SHRI R. R. RAO (*Alternate*)
SHRI D. AJITHA SIMHA,
Director (Civ Engg)

Representing

Directorate General of Technical Development
(Ministry of Industrial Development)
Oil & Natural Gas Commission, Dehra Dun
Hindustan Steel Limited, Ranchi
Koooverji Devshi & Co (P) Ltd, Bombay
Newage Industries, Surendranagar
DGL Private Limited, New Delhi
Directorate General of Supplies & Disposals
(Ministry of Supply)
Synthetics & Chemicals Ltd, Bareilly
Municipal Corporation of Delhi (Delhi Fire
Service)
Heavy Engineering Corporation Ltd, Ranchi
Directorate of Civil Defence (Operation),
Government of Maharashtra
Director General, ISI (*Ex-officio Member*)

Secretary

SHRI K. M. MATHUR
Deputy Director (Civ Engg), ISI

Fire Fighting Equipment Subcommittee, BDC 22 : 2

Convener

SHRI P. N. MEHROTRA
Ministry of Home Affairs

Members

SHRI G. B. MENON (*Alternate to*
Shri P. N. Mehrotra)
SHRI P. K. BHARUCHA
Insurance Association of India, Regional
Council, Bombay
SHRI A. CHATTERJI (*Alternate*)
SHRI S. C. CHATTERJEE
SHRI P. N. GHOSH
SHRI A. N. AHLUWALIA (*Alternate*)
SHRI S. K. GUPTA
Directorate General of Inspection (Ministry of
Defence)
SHRI B. K. GHOSH (*Alternate*)
SHRI H. C. RAI CHOUDHURY
Directorate General of Civil Aviation (Ministry
of Tourism & Civil Aviation), New Delhi
SHRI D. K. SIRKAR
Synthetics & Chemicals Ltd, Bareilly

Indian Standard
 SPECIFICATION FOR
 GALVANIZED MILD STEEL FIRE BUCKET
 (*First Revision*)

0. FOREWORD

0.1 This Indian Standard (First Revision) was adopted by the Indian Standards Institution on 15 March 1974, after the draft finalized by the Fire Fighting Sectional Committee had been approved by the Civil Engineering Division Council.

0.2 As one of the important items of first-aid fire fighting equipment, fire buckets have to conform to certain essential requirements in regard to shape, design, construction and finish. This standard has been prepared with a view to providing guidance both in manufacture and purchase of galvanized mild steel fire bucket of proper design and construction. This standard was published in the year 1963. This first revision has been prepared to incorporate the revised design of bucket as recommended by Ordnance Factory, Dum Dum.

0.3 This edition 2.2 incorporates Amendment No. 1 (September 1981) and Amendment No. 2 (February 2001). Side bar indicates modification of the text as the result of incorporation of the amendments.

0.4 For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS : 2-1960*. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

1. SCOPE

1.1 This standard lays down the requirements regarding material, dimensions, manufacture, finish and tests of galvanized mild steel fire bucket of 10 litres nominal capacity.

2. MATERIAL

2.1 Mild Steel Black Sheets — Mild steel black sheets used for the manufacture of buckets shall conform to Grade St 34 or Grade St 42 of IS : 1079-1968†.

*Rules for rounding off numerical values (*revised*).

†Specification for hot rolled carbon steel sheet and strip (*second revision*).

IS : 2546 - 1974

2.2 Mild Steel Rod — Mild steel rod used for the top and bottom handles shall conform to IS : 226-1969*.

2.3 Mild Steel Wire — Mild steel wire used for stiffening the top rim shall conform to IS : 280-1962†.

2.4 Paints — Paints used for painting of fire buckets shall conform to the appropriate Indian Standards given in Table 1. The shade of the outside colour shall be fire red conforming to Shade No. 536 of IS : 5-1978‡.

TABLE 1 PAINTS FOR PAINTING OF FIRE BUCKETS

SL No.	PURPOSE	REFERENCE TO INDIAN STANDARDS	
		When Oil Paint Finish is Required	When Enamel Finish is Required
(1)	(2)	(3)	(4)
i)	White paints for painting the inside	IS : 641-1964*	IS : 2932-1964†
ii)	Red paints for painting the outside	IS : 120-1962‡	
iii)	Black paint for painting handles, ears and letters	IS : 128-1962§	

*Specification for ready mixed paint, brushing, finishing, interior, semi-gloss for general purposes, white (*revised*).

†Specification for enamel, synthetic, exterior, Type 1 (a) under-coating, (b) finishing, colour as required.

‡Specification for ready mixed paint, brushing, finishing, semi-gloss, for general purposes to Indian Standard colours.

§Specification for ready mixed paint, brushing, finishing, semi-gloss, for general purposes, black (*revised*).

3. SHAPE AND ESSENTIAL DIMENSIONS

3.1 The shape and the essential dimensions of fire bucket shall conform to those shown in Fig. 1.


4. MANUFACTURE

4.1 Body — The body shall be in two halves which shall be joined together by butt welding. The top rim of the body shall be wired and uniformly beaded. The beading shall be fully formed without gaps. The thickness of body shall be 1 mm and diameter of beading wire 3.55 mm.

*Specification for structural steel (standard quality) (*fourth revision*).

†Specification for mild steel wire for general engineering purposes (*revised*).

‡Colours for ready mixed paints (*third revision*).

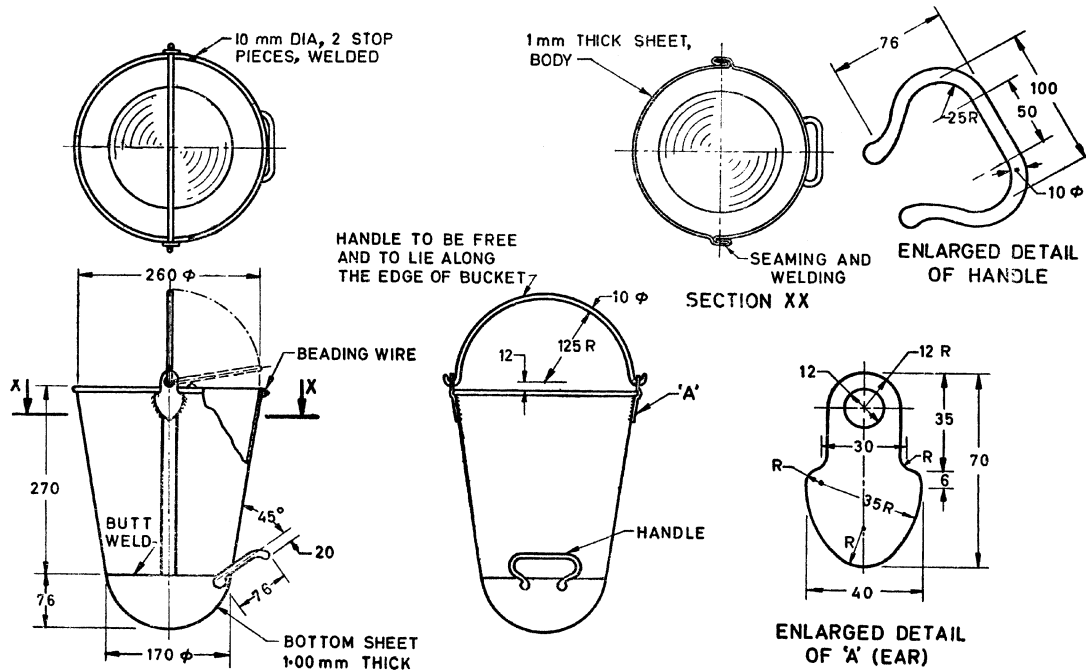

All dimensions in millimetres.

FIG. 1 FIRE BUCKET — SHAPE AND ESSENTIAL DIMENSIONS

IS : 2546 - 1974

4.2 Bottom — The bottom shall be dished and shall be joined to the body by butt welding so that there is no raw edge or crevice on the inside of the bucket. The thickness of the bottom sheet shall be 1 mm.

4.3 Ears — The ears shall be made of mild steel sheet and shall be fitted to the body at the top by means of welding with the flat head on the side. The thickness of sheet for ears shall be 2.8 mm.

4.4 Top Handle — The top handle shall be of mild steel rod of 10 mm in diameter with its ends bent up as shown in Fig. 1.

4.5 Bottom Handle — The bottom handle shall be of mild steel rod of 10 mm in diameter and it shall be joined to the bottom by welding as shown in Fig. 1. The grip shall have no sharp edges.

4.6 General — All gas welds shall be free from porosity, blow holes and brittleness.

5. FINISH

5.1 All parts of the bucket shall be finished smooth and sharp edges rounded off.

5.2 The bucket shall be galvanized after manufacture as per IS : 2629-1966*. The thickness of coating of zinc conforming to IS : 13229-1991 Specification for zinc for galvanizing on any portion shall be not less than 0.06 g/cm^2 (both sides inclusive). Alternately, it may also be galvanized of lead tin alloy to a thickness of not less than 0.012 mm.

5.3 Bucket shall, in addition to galvanizing, be painted with two coats of white paint on the inside and two coats of red paint on the outside (see also **2.4**). The handles and the ears shall be painted with two coats of black paint.

5.3.1 The word 'FIRE' shall be painted in black centrally on the outside; its letters shall be 75 mm high, and approximately 12 mm thick.

6. PERFORMANCE REQUIREMENTS

6.1 The bucket shall be water tight and tested for leakage as given in **6.1.1** and **6.1.2**.

6.1.1 The bucket shall be filled with water to the brim and kept for 15 minutes. The bucket shall not show any sign of leakage during this period.

6.1.2 A water tank of suitable size and full of water shall be used for conducting the test. The dry empty bucket with its top facing upwards shall be pressed down the water vertically taking care that the top is at least 6 mm above the water level. It shall be observed whether any

*Recommended practice for hot-dip galvanizing of iron and steel.

water gets into the bucket from the bottom or sides of the bucket. If any water enters the bucket, it shall be considered to have failed the test.

6.1.2.1 The bucket shall be withdrawn, reversed (with top downwards) and again pressed down the water vertically without agitating the water. Should any air bubble be seen escaping through the water, the bucket shall be considered to have failed the test.

7. INSPECTION AND MANUFACTURER'S CERTIFICATE

7.1 The purchaser or his representative shall, if desired, be granted facilities for inspection of finished goods prior to despatch at the manufacturer's works.

8. SCALE OF SAMPLING AND CRITERION FOR CONFORMITY

8.1 Lot — In any consignment, all the buckets from the same batch of manufacture shall be grouped together to constitute a lot.

8.2 Sample Size — The number of buckets to be selected from the lot shall depend on the size of the lot and shall be in accordance with col (1) and (2) of Table 2. These buckets shall be selected at random from at least 10 percent of the packages subject to a minimum of 3; equal number of buckets being selected from each such package. If the number of packages is less than 3, buckets from all the packages shall be selected.

TABLE 2 SCALE OF SAMPLING AND CRITERION FOR CONFORMITY

(Clauses 8.2 and 8.4)

No. OF BUCKETS IN THE LOT	SAMPLE SIZE	PERMISSIBLE NO. OF DEFECTIVE BUCKETS
(1)	(2)	(3)
Less than 15	All	0
15 to 200	15	1
201 to 300	20	1
301 to 500	30	2
501 to 800	40	3
801 to 1 300	55	3
1 301 to 3 200	75	4
3 201 and above	115	6

NOTE — The sampling plan given here is such that lots with 2.5 percent or less defectives will be accepted most of the times.

IS : 2546 - 1974

8.3 Number of Tests — All the buckets selected as in **8.2** shall be inspected for shape and dimensions (*see 3*), manufacturing defects (*see 4*) and finish (*see 5*) and tested for leakage (*see 6*). Any bucket which fails to satisfy the requirement of any one or more of the characteristics shall be considered as defective bucket.

8.4 Criterion for Conformity — The lot shall be considered as conforming to the requirements of this standard if the number of defective buckets among those inspected does not exceed the corresponding number given in col (3) of Table 2; otherwise it shall be considered as not conforming to the requirements of the standard.

9. MARKING AND PACKING

9.1 Each bucket shall be stamped or embossed on its side with the manufacturer's name or trade-mark, year of manufacture and its capacity. Embossing shall be sufficiently deep so that the marking remains quite legible after galvanizing.

9.1.1 The fire bucket may also be marked with the ISI Certification Mark.

NOTE — The use of the ISI Certification Mark is governed by the provisions of the Indian Standards Institution (Certification Marks) Act and the Rules and Regulations made thereunder. The ISI Mark on products covered by an Indian Standard conveys the assurance that they have been produced to comply with the requirements of that standard under a well-defined system of inspection, testing and quality control which is devised and supervised by ISI and operated by the producer. ISI marked products are also continuously checked by ISI for conformity to that standard as a further safeguard. Details of conditions under which a licence for the use of the ISI Certification Mark may be granted to manufacturers or processors, may be obtained from the Indian Standards Institution.

9.2 Buckets shall be suitably packed as required by the purchaser.

Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act, 1986* to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in the course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Director (Publications), BIS.

Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Catalogue' and 'Standards : Monthly Additions'.

This Indian Standard has been developed by Technical Committee : BDC 22 and amended by CED 22

Amendments Issued Since Publication

Amend No.	Date of Issue
Amd. No. 1	September 1981
Amd. No. 2	February 2001

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002.
Telephones: 323 01 31, 323 33 75, 323 94 02

Telegrams: Manaksanstha
(Common to all offices)

Regional Offices:

	Telephone
Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg NEW DELHI 110002	{ 323 76 17 323 38 41
Eastern : 1/14 C. I. T. Scheme VII M, V. I. P. Road, Kankurgachi KOLKATA 700054	{ 337 84 99, 337 85 61 337 86 26, 337 91 20
Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160022	{ 60 38 43 60 20 25
Southern : C. I. T. Campus, IV Cross Road, CHENNAI 600113	{ 235 02 16, 235 04 42 235 15 19, 235 23 15
Western : Manakalaya, E9 MIDC, Marol, Andheri (East) MUMBAI 400093	{ 832 92 95, 832 78 58 832 78 91, 832 78 92
Branches : AHMEDABAD. BANGALORE. BHOPAL. BHUBANESHWAR. COIMBATORE. FARIDABAD. GHAZIABAD. GUWAHATI. HYDERABAD. JAIPUR. KANPUR. LUCKNOW. NAGPUR. NALAGARH. PATNA. PUNE. RAJKOT. THIRUVANANTHAPURAM. VISHAKHAPATNAM	